

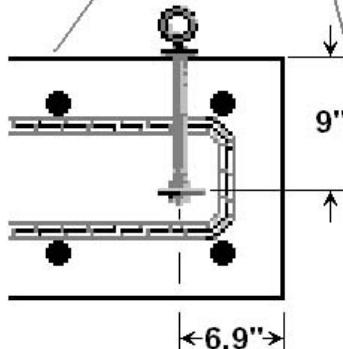
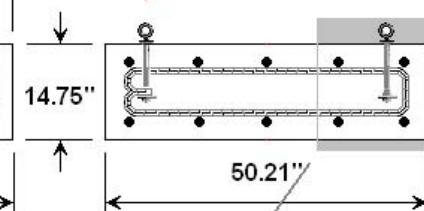
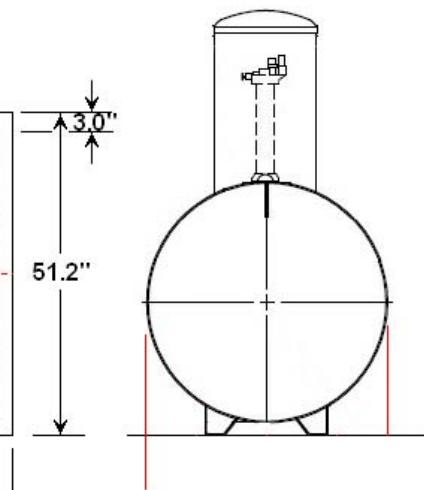
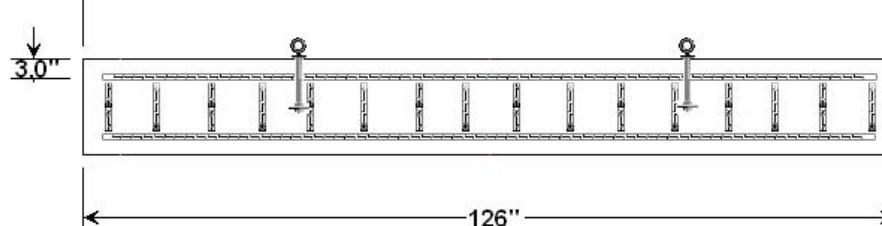
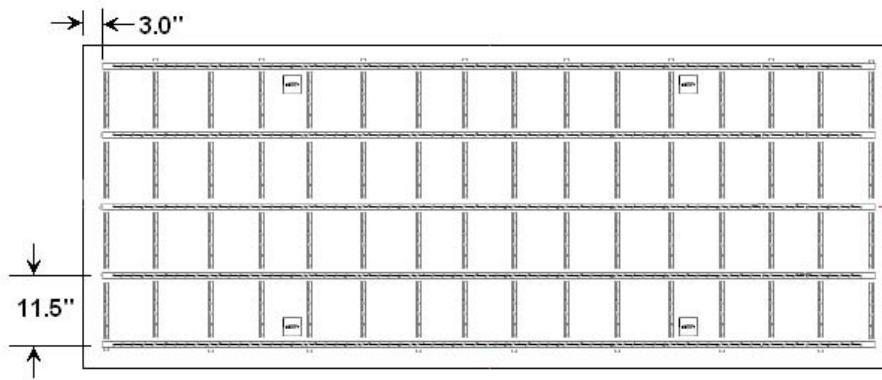


Pipinich Downs
 500 UG Propane Tank
 Ballast Weight
 Concrete Reinforcement Detail

2 Cu. Yards 5K psi Concrete
 (10) #5 @ 11.5 OC T&B
 (16) #4 Ties @ 8 OC (Hooked)

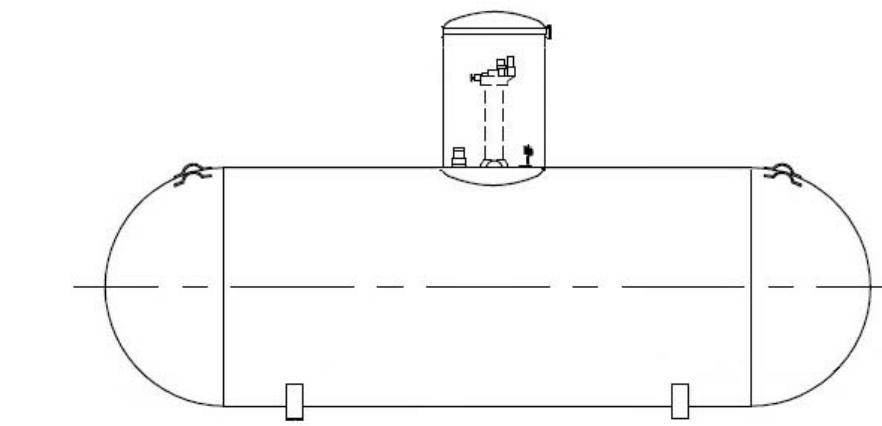

(4) 1/2" x 10" Forged Eye Bolts (2200 lbs) secure tank to weight. Galvanized eyebolts cast in place 9" deep to 3"x3" x 3/16th" foundation plate washers secured top and bottom with round washers and nuts. Eye bolts rated 2200 lbs. Tank secured to ballast by coated galvanized steel cable clamped in place at top of tank. Sacrificial anode and foundation sump pump protect the installation.

